ADDENDUM 4

DATE: November 30, 2016

PROJECT: MSB First Floor Infill LRC 3 & 4

RFP NO: 744-R1705

OWNER: The University of Texas Health Science Center at Houston

TO: Prospective Proposers

This Addendum forms part of and modifies Proposal Documents dated, October 19, 2016, with amendments and additions noted below.

The questions below were submitted before the second deadline and the responses are in orange:

1. Please clarify the design intent for F13 as noted in ADD 03

a. Room Finish Schedule, sheet A-540 calls out material as CPT-2

Finish Type Mark	Floor	Base	Wall	Ceiling	Misc/Trim	Door	Frame	Notes
F1	CPT1	RSC	PT1	ACT2		WV	FP11	
nem	~~V94~~	~~~~	Chan	MACH MACH	nama	2000	Socios	
F13	CPT2	R85	PTI	AC12		WV	1971	1
F14	Default Floor	RBS	PTI	ACTZ	de la constanta de la constant	WV	1971	5

CPT2 (9223 Hops) will not be used at Level 1; it will be omitted.

b. Finish Material Schedule, sheet A-540 only calls out a change to CPT-1 & VCT-1

		Finish Material	Schedule		
Type Mark	Description	Manufacturer Pattern/Line		Color	Notes
Floors CPT1	Carpet		furrows II	9214 Georgia Clay	m/2
VC11	Virryl composition tile	Armstrong	Imperial Texture	51810 Washed Linen	K
Base	L	- Cumun			
RBC	Rubber base, cove	Roppe		P193 Black/Brown	

CPT2 will be omitted.

2. Please confirm mini blinds size of ½" and color of brushed aluminum.

Blinds are to be 1" and color is Natural Stone.

 Drawing A-161 Detail 1 completely demolishes the ground floor group study rooms and is not shown to be rebuilt after completion of construction. Is this the design intent? If not, please provide a renovation plan detailing the build back.

Walls being demolished on the ground floor are to be built back up; ceiling grid removed at ground level needs to be reinstalled, doors, frame and hardware are to be removed and reinstalled. All floor finishes are to be preserved; if damaged or removed GC to reinstall to match the existing finishes. Additional information provided in Addendum 4 drawings below.

- Please confirm the door pattern/line and color shown on Drawing A-540 are to be installed on both ground floor and 1st floor.
 Doors on ground floor are to be existing. No new doors at this level.
- 5. Please confirm whether the new column wraps are to the fire rated at the steel connection plates along column lines A & H.

 Column gyp wraps are to be (2) two hour fire rated. See Addendum 4 drawings below.
- 6. The full set of "issued for construction" docs we received are dated 3/31/16; Addenda 3 shows as dated 11/14/16, but shows a 7/8/16 date for the "issue for construction" refer to both S-200 drawings between 3/31/16 date and 11/14/16 date. There are some new details not clouded and we did not receive a S-100 drawing relating to the new details. Please advise if there is a different full set of "issued for construction" plans dated 7/8/16. Refer to drawings below.
- 7. The response on addendum #3 regarding the prevailing wage rates for this project references appendix 7 of the bid documents. However, I do not see any information about prevailing wage rates in this appendix, and don't see mention of it in the specs. Can we get a clarification on the required wage rates please?
 Appendix 7 Special Conditions has been revised on our website and contains the correct prevailing wage rates for the project. Please go to http://www.uthouston.edu/buy/bid-list.htm.

Notice to All Bidders

This Addendum forms a part of the Contract Documents and modifies the original Specifications and Drawings, issued 8 July 2016, to the extent noted hereinafter.

All parties of interest shall take careful note of this Addendum so that proper allowance is made in all computations, estimates and contracts and so that all trades affected are fully advised in the performance of work that will be required by them.


This Addendum supersedes all previous Drawings, Specifications, and instructions pertaining to these items.

A. Drawings

Item 04.01


The following listed drawings, dated 30 November 2016 are being issued as part of Addendum No. Four (04) as REVISED:

A-110	Floor Plan East
A-111	Floor Plan West
A-161	Demolition Reflected Ceiling Plan – Ground Level
A-162	Reflected Ceiling Plans – Ground Level
A-163	Demolition Reflected Ceiling Plan – Level 1
A-164	Reflected Ceiling Plans – Level 1
A-520	Partition Types and Interior Construction Details
A-540	Door and Window Details

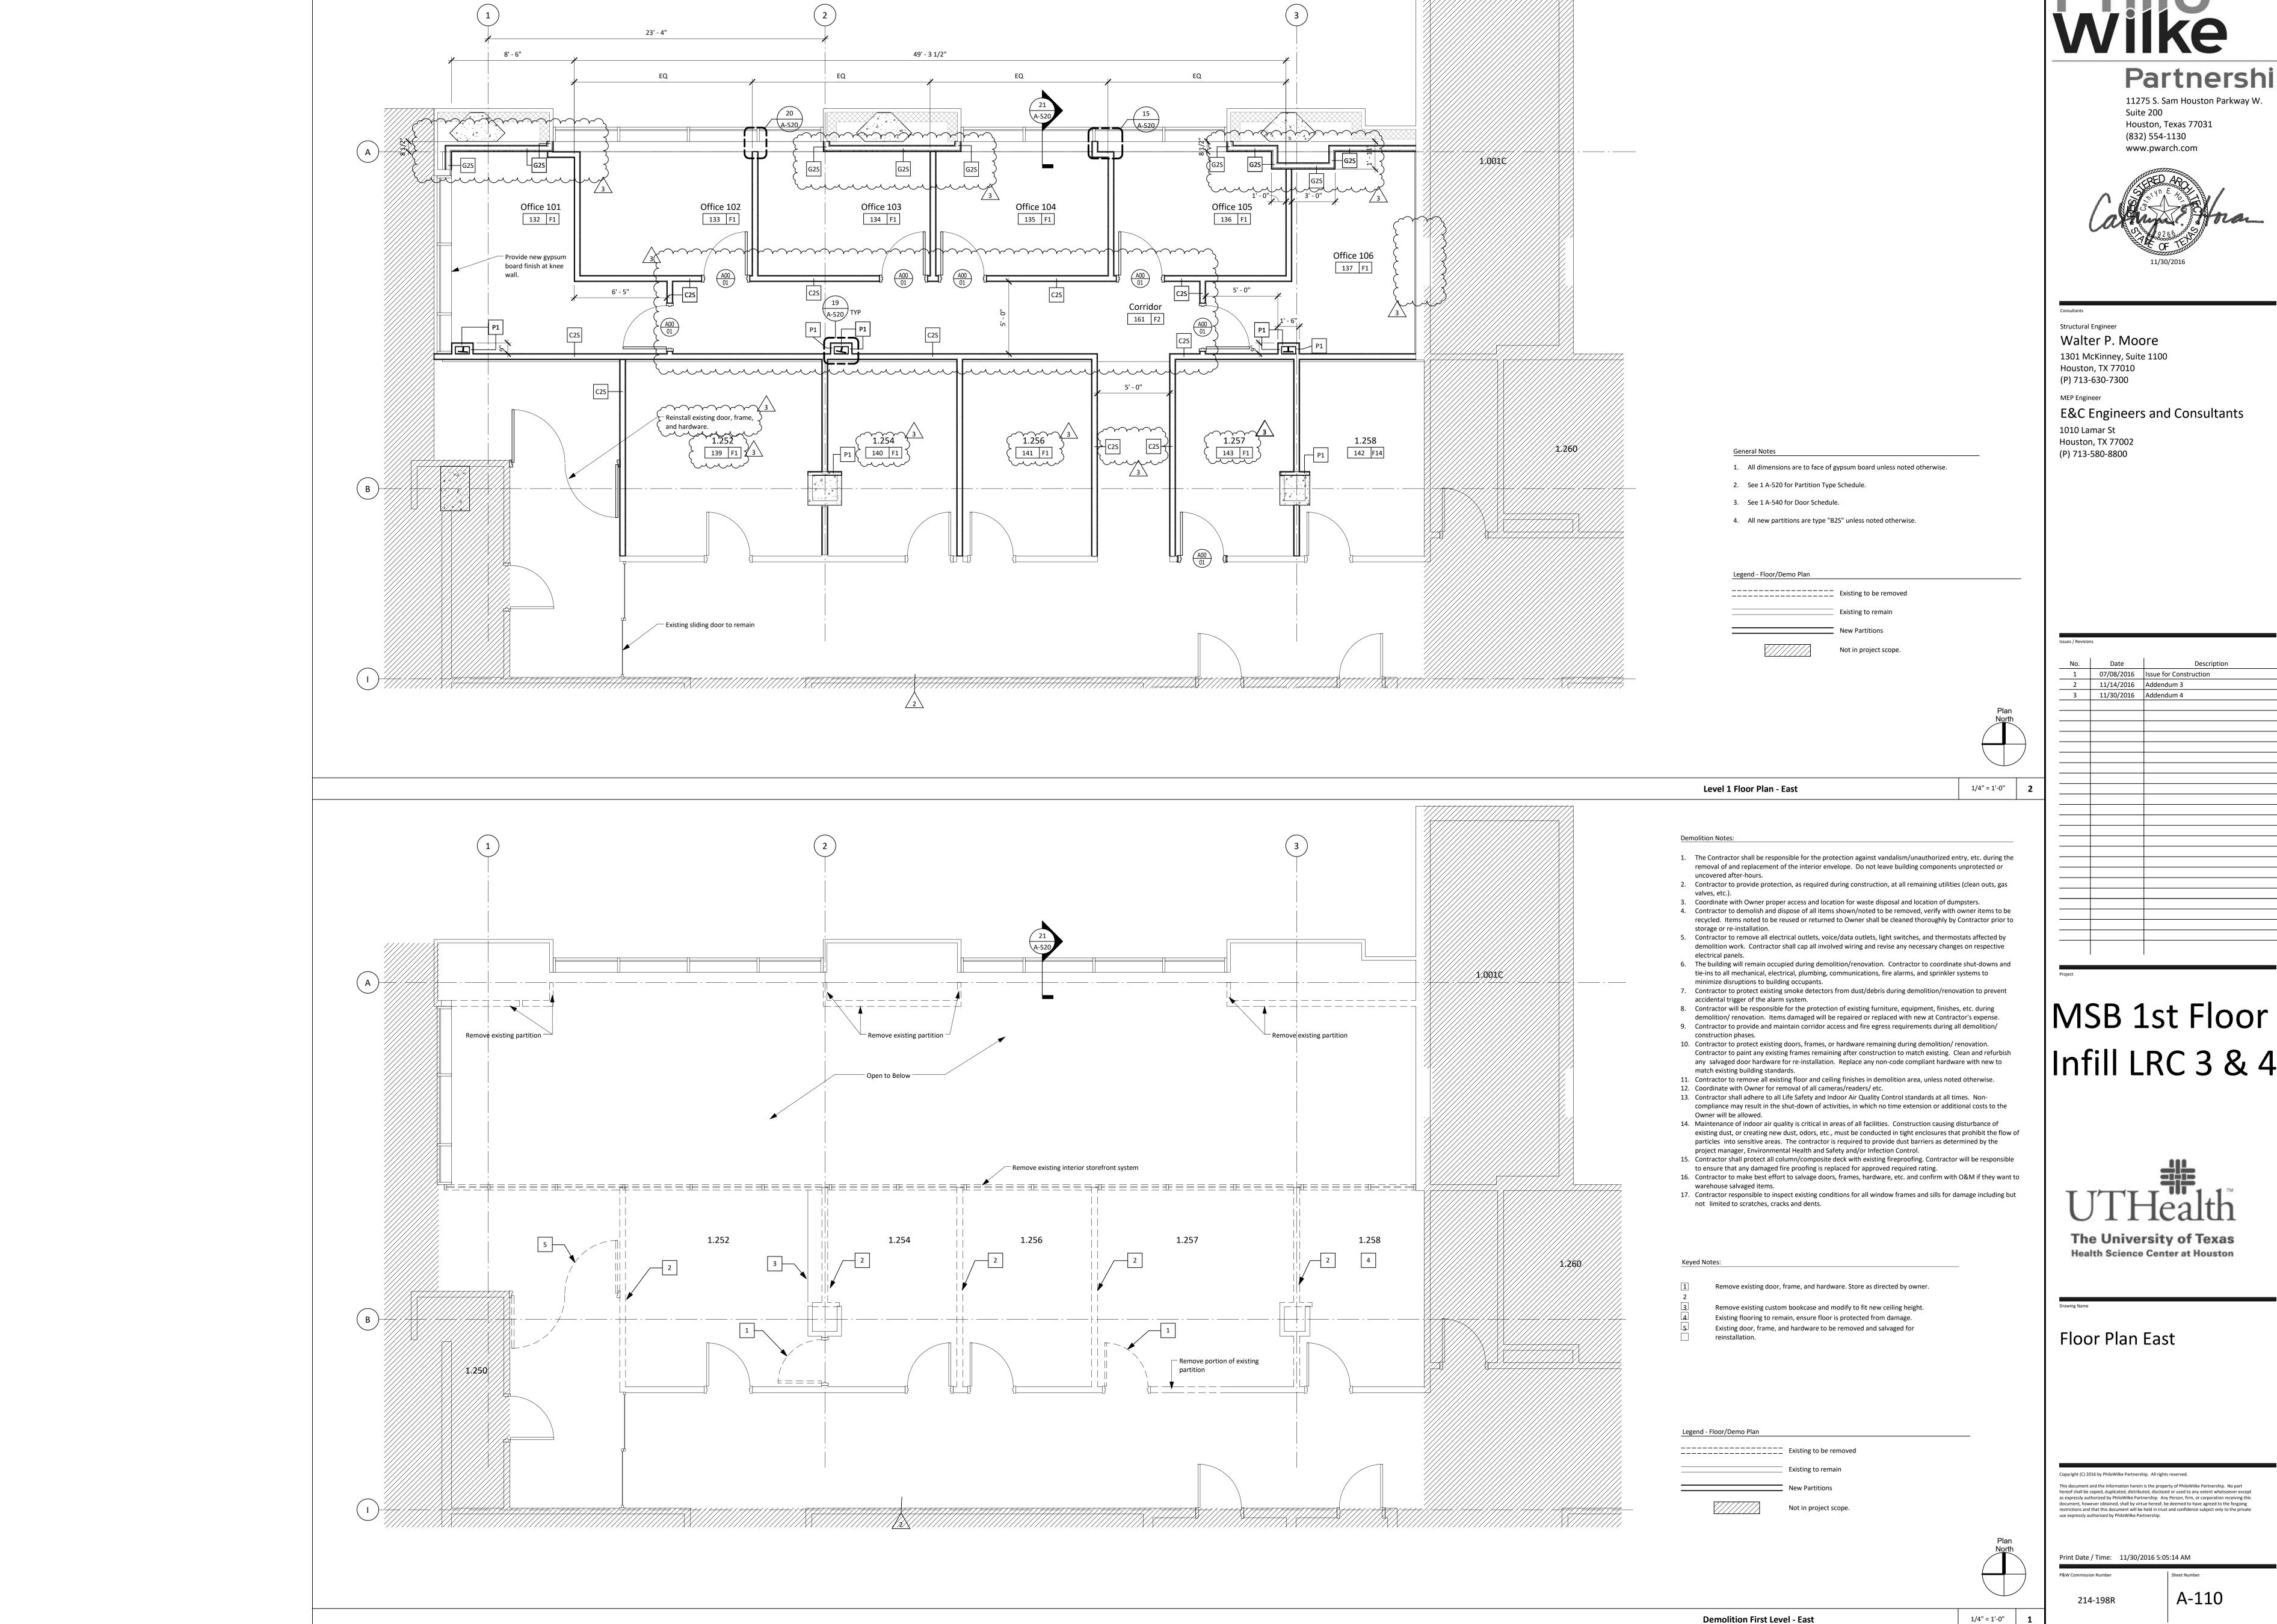

No.	Date	Description
1	07/08/2016	Issue for Construction
2	11/14/2016	Addendum 3
3	11/30/2016	Addendum 4

Infill LRC 3 & 4

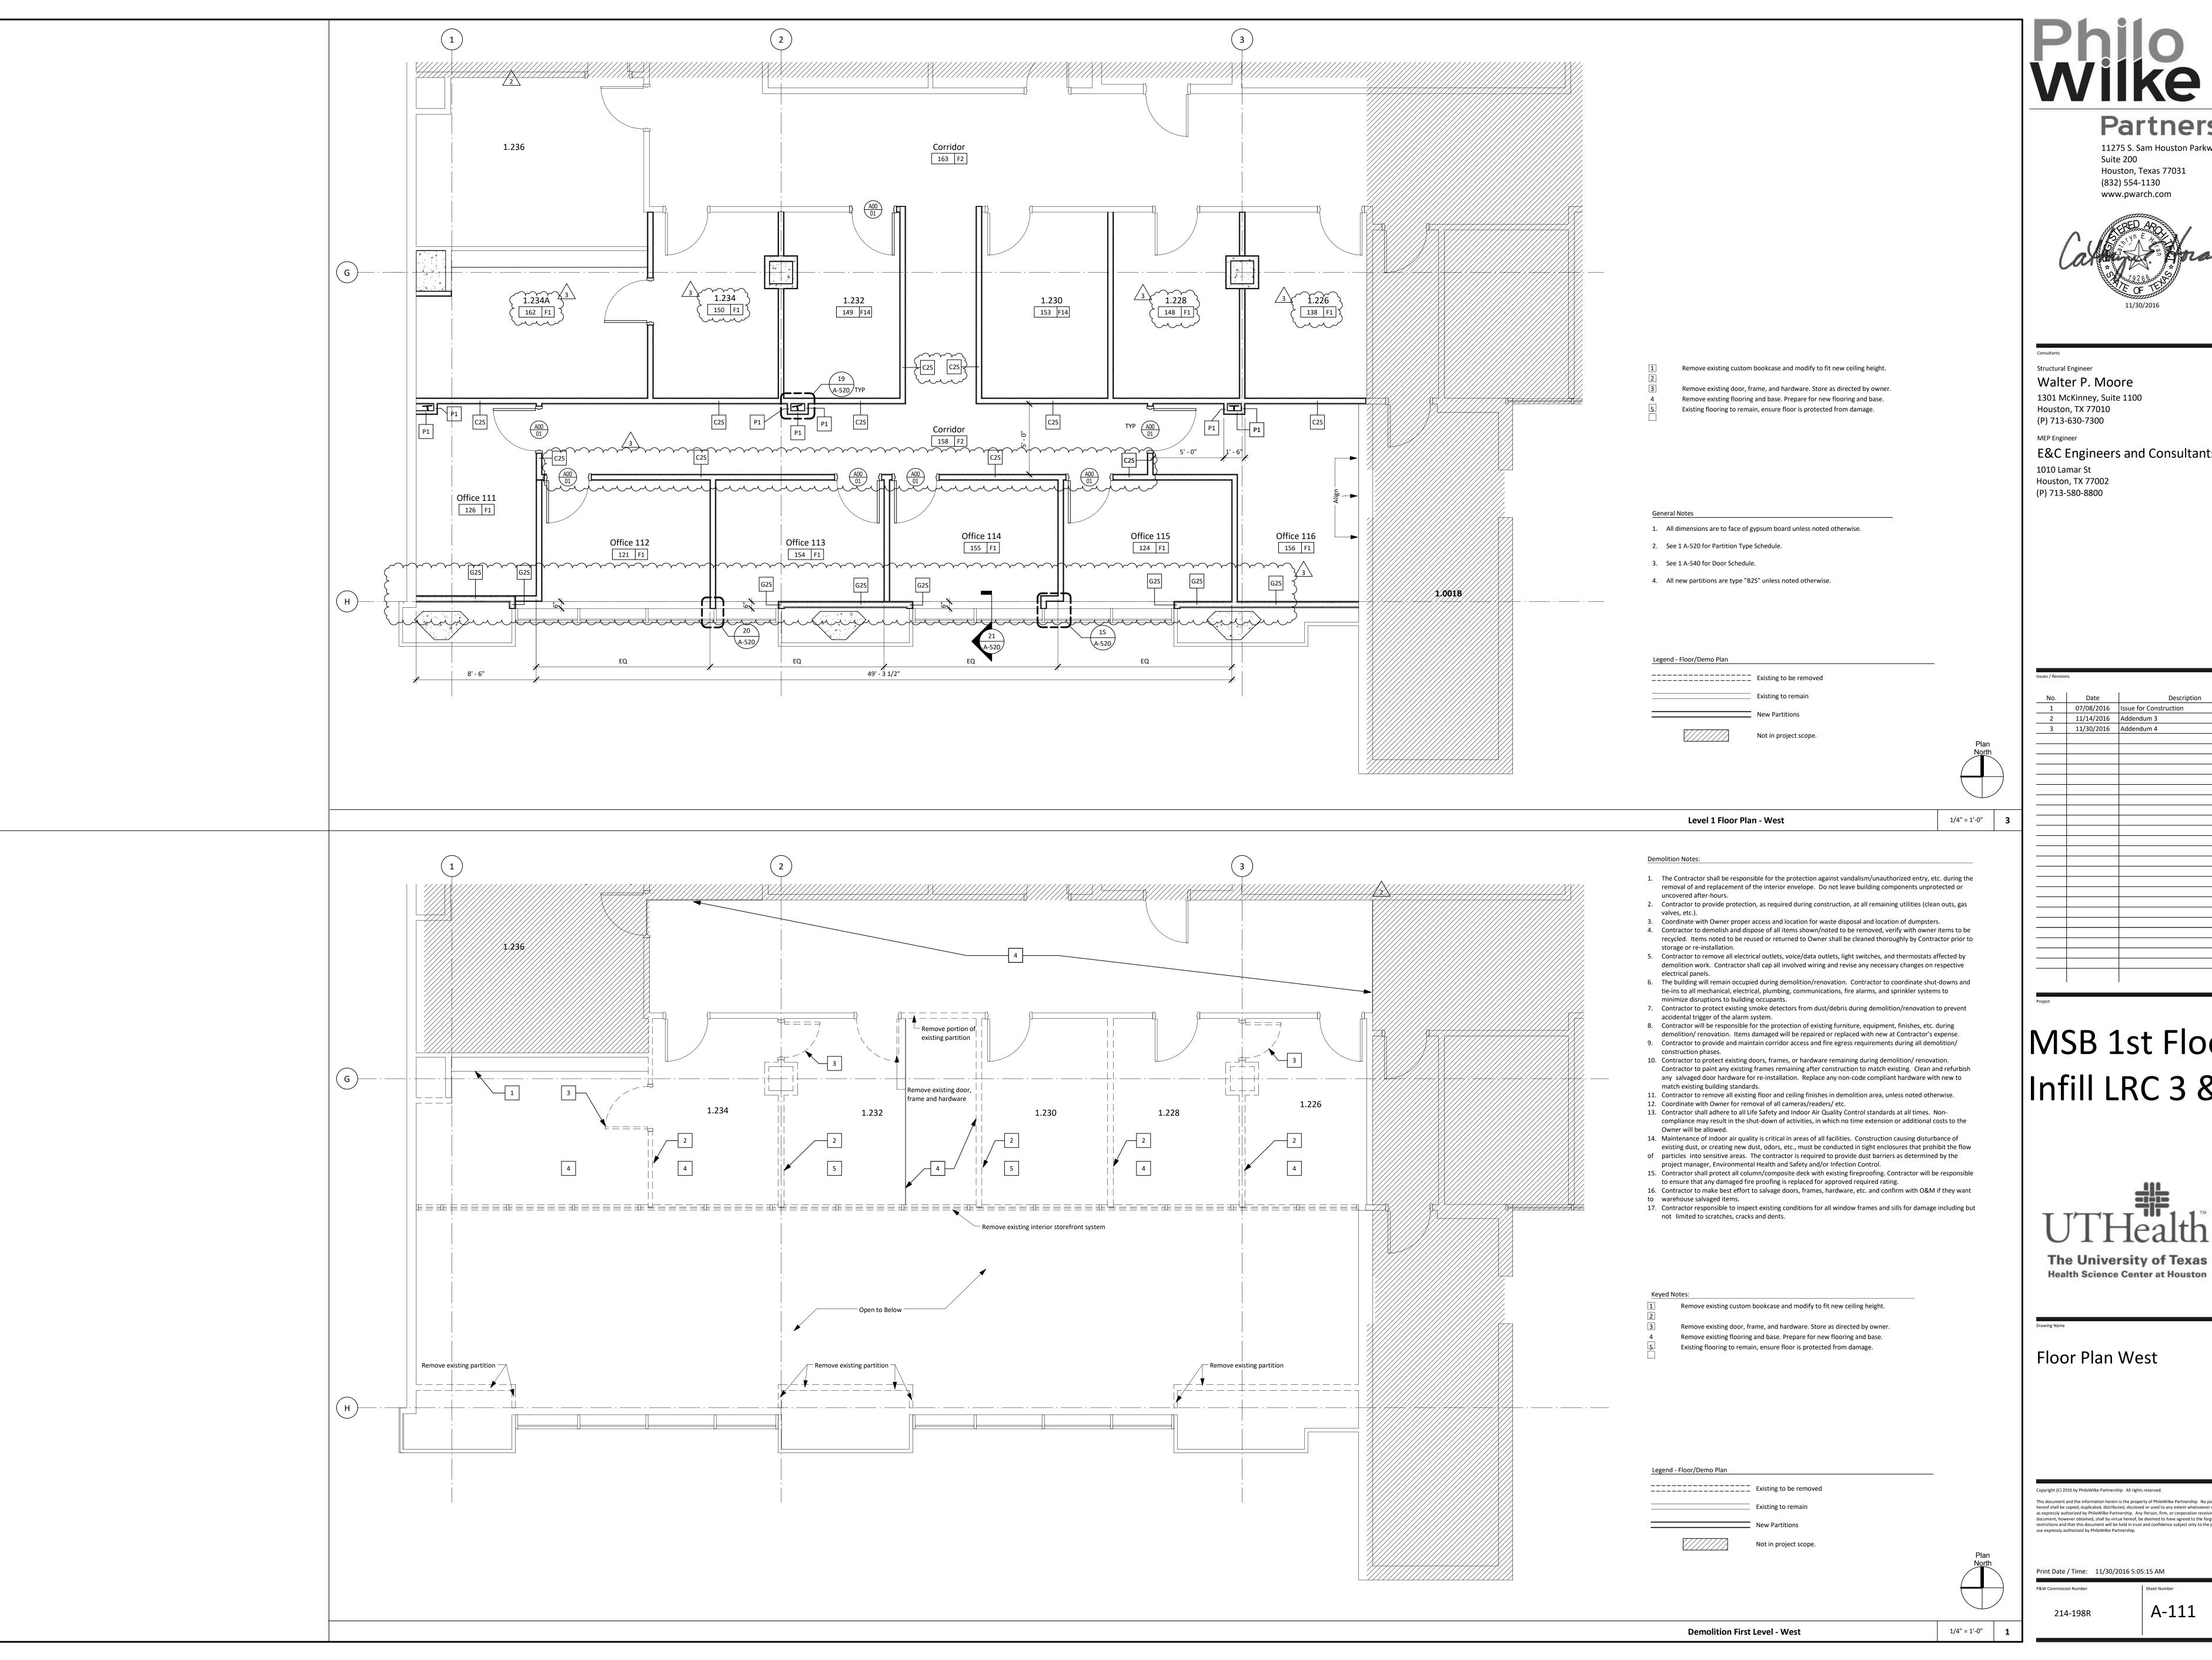

11275 S. Sam Houston Parkway W. Houston, Texas 77031



E&C Engineers and Consultants


Issues / Revisio	ns	
No.	Date	Description
1	07/08/2016	Issue for Construction
2	11/14/2016	Addendum 3
3	11/30/2016	Addendum 4

MSB 1st Floor Infill LRC 3 & 4



This document and the information herein is the property of PhiloWilke Partnership. No part hereof shall be copied, duplicated, distributed, disclosed or used to any extent whatsoever except as expressly authorized by PhiloWilke Partnership. Any Person, firm, or corporation receiving this document, however obtained, shall by virtue hereof, be deemed to have agreed to the forgoing restrictions and that this document will be held in trust and confidence subject only to the private

A-111

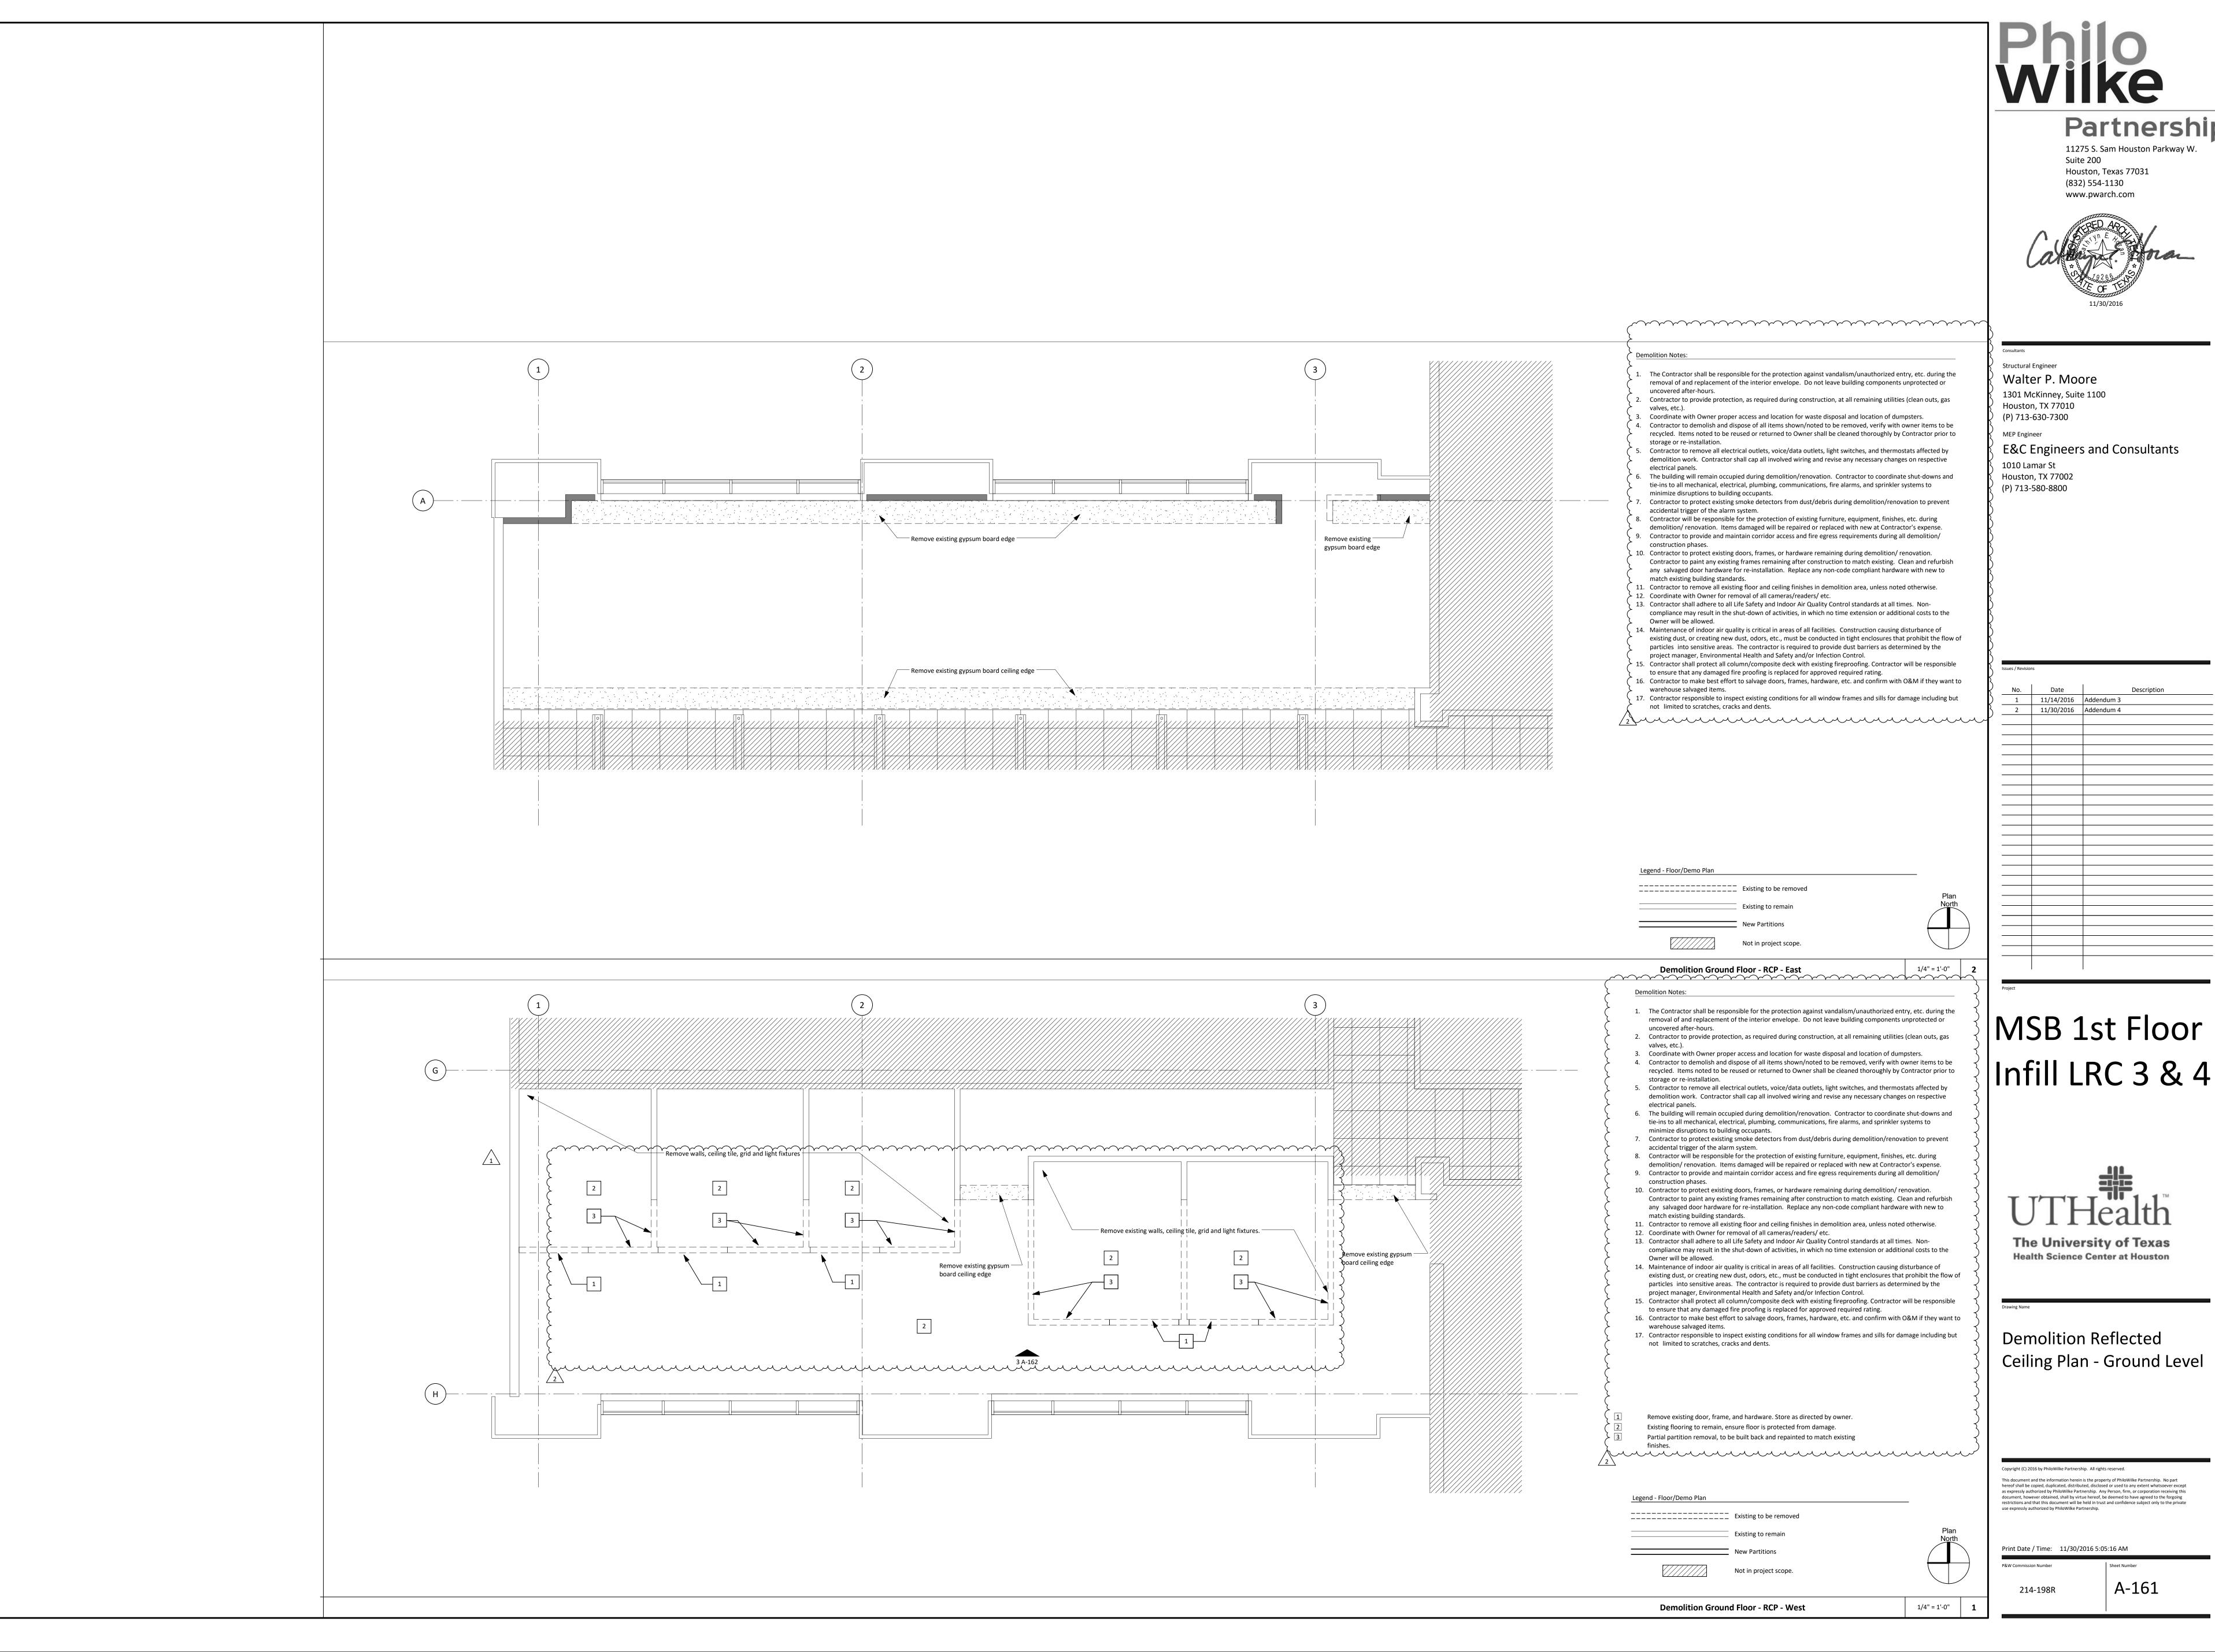





Partnership 11275 S. Sam Houston Parkway W.



E&C Engineers and Consultants


Issues / Revision	ons	
No.	Date	Description
1	07/08/2016	Issue for Construction
2	11/14/2016	Addendum 3
3	11/30/2016	Addendum 4
-		

MSB 1st Floor Infill LRC 3 & 4



Reflected Ceiling Plans

This document and the information herein is the property of PhiloWilke Partnership. No part hereof shall be copied, duplicated, distributed, disclosed or used to any extent whatsoever except as expressly authorized by PhiloWilke Partnership. Any Person, firm, or corporation receiving this

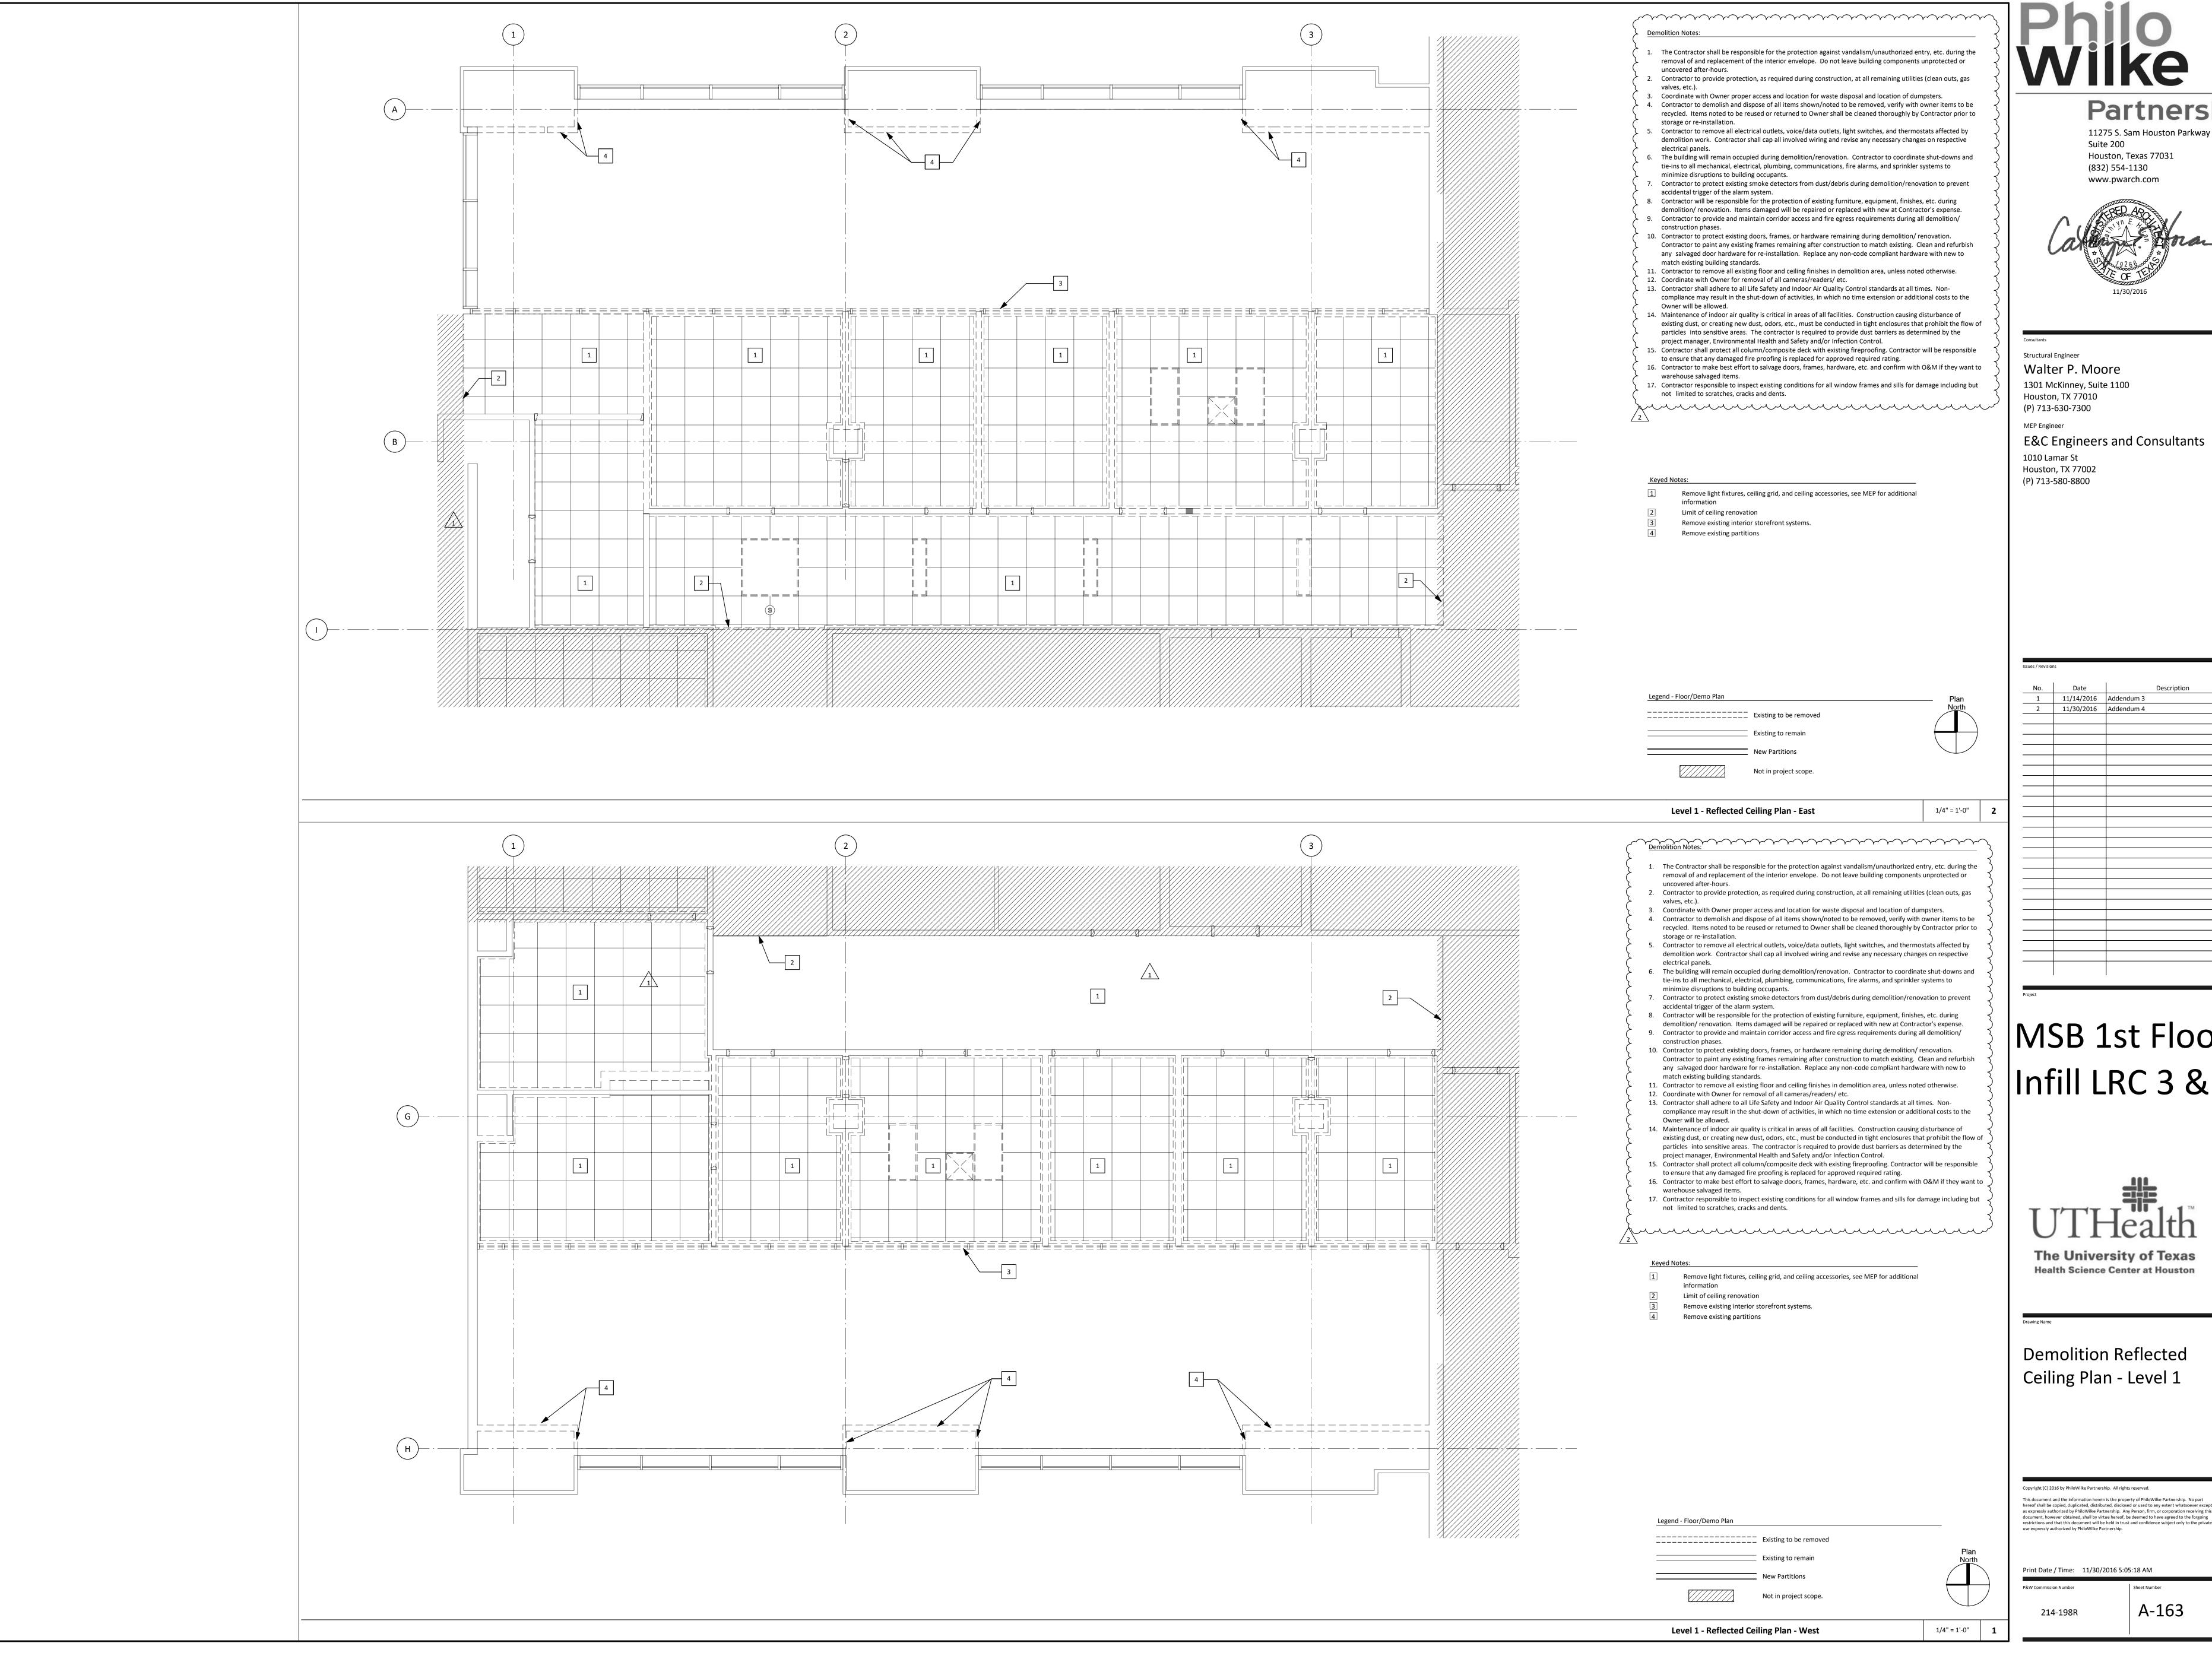

11275 S. Sam Houston Parkway W. Suite 200 Houston, Texas 77031 (832) 554-1130 www.pwarch.com



Structural Engineer Walter P. Moore 1301 McKinney, Suite 1100

(P) 713-630-7300

E&C Engineers and Consultants 1010 Lamar St Houston, TX 77002

11/14/2016 Addendum 3 2 11/30/2016 Addendum 4

MSB 1st Floor Infill LRC 3 & 4



The University of Texas **Health Science Center at Houston**

Demolition Reflected Ceiling Plan - Level 1

Copyright (C) 2016 by PhiloWilke Partnership. All rights reserved. This document and the information herein is the property of PhiloWilke Partnership. No part hereof shall be copied, duplicated, distributed, disclosed or used to any extent whatsoever except as expressly authorized by PhiloWilke Partnership. Any Person, firm, or corporation receiving this document, however obtained, shall by virtue hereof, be deemed to have agreed to the forgoing

Print Date / Time: 11/30/2016 5:05:18 AM Sheet Number

214-198R





E&C Engineers and Consultants

No.	Date	Description
1	07/08/2016	Issue for Construction
2	11/14/2016	Addendum 3
3	11/30/2016	Addendum 4

MSB 1st Floor Infill LRC 3 & 4




Health Science Center at Houston


Reflected Ceiling Plans -

This document and the information herein is the property of PhiloWilke Partnership. No part hereof shall be copied, duplicated, distributed, disclosed or used to any extent whatsoever except as expressly authorized by PhiloWilke Partnership. Any Person, firm, or corporation receiving this document, however obtained, shall by virtue hereof, be deemed to have agreed to the forgoing restrictions and that this document will be held in trust and confidence subject only to the private use expressly authorized by PhiloWilke Partnership.

Print Date / Time: 11/30/2016 5:05:19 AM

Sheet Number

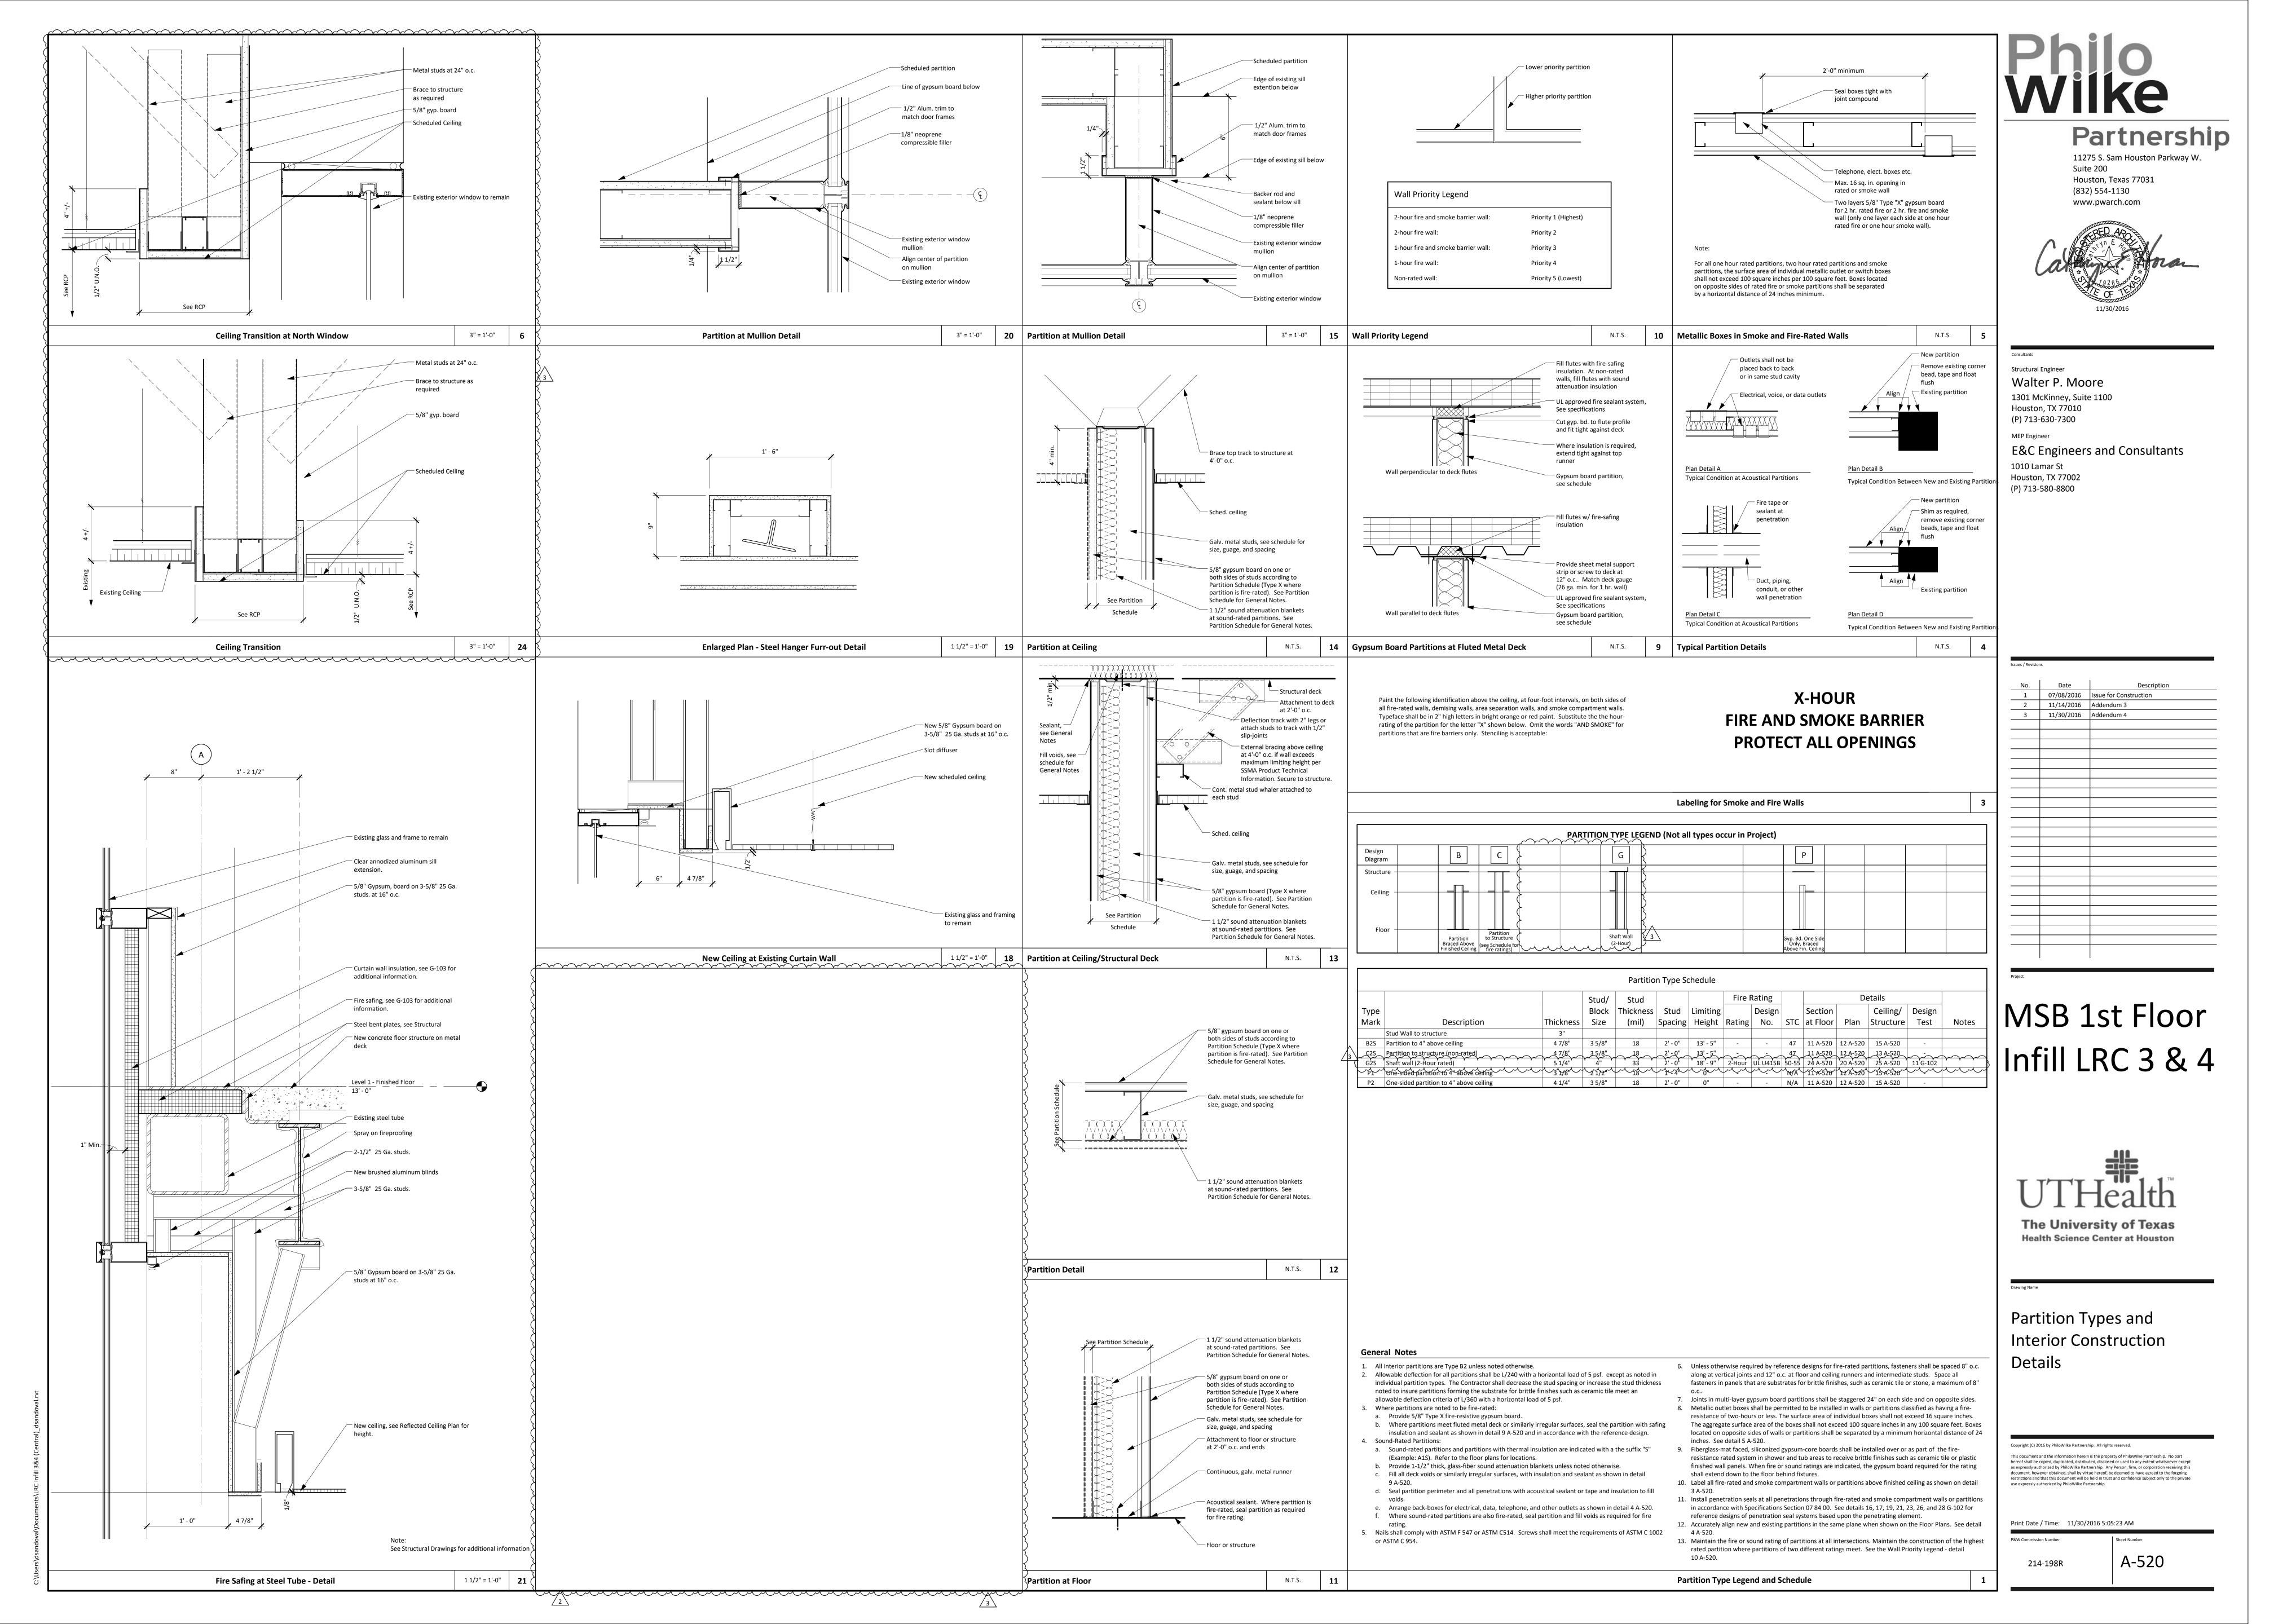

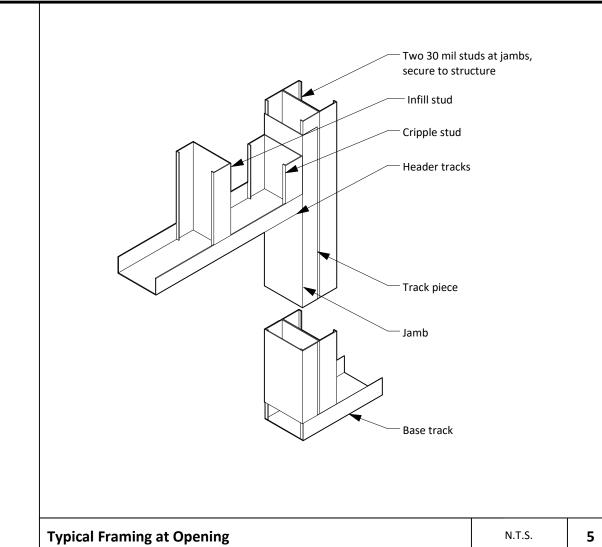

Partnership 11275 S. Sam Houston Parkway W. Suite 200 Houston, Texas 77031 (832) 554-1130 www.pwarch.com

Structural Engineer

(P) 713-580-8800

Walter P. Moore 1301 McKinney, Suite 1100 Houston, TX 77010 (P) 713-630-7300

MEP Engineer **E&C Engineers and Consultants** 1010 Lamar St Houston, TX 77002

07/08/2016 Issue for Construction 11/14/2016 Addendum 3 3 11/30/2016 Addendum 4

MSB 1st Floor Infill LRC 3 & 4



Door and Window Details

Copyright (C) 2016 by PhiloWilke Partnership. All rights reserved. This document and the information herein is the property of PhiloWilke Partnership. No part hereof shall be copied, duplicated, distributed, disclosed or used to any extent whatsoever except as expressly authorized by PhiloWilke Partnership. Any Person, firm, or corporation receiving this document, however obtained, shall by virtue hereof, be deemed to have agreed to the forgoing restrictions and that this document will be held in trust and confidence subject only to the private


Print Date / Time: 11/30/2016 5:05:24 AM

use expressly authorized by PhiloWilke Partnership.

P&W Commission Number

A-540 214-198R

Sheet Number

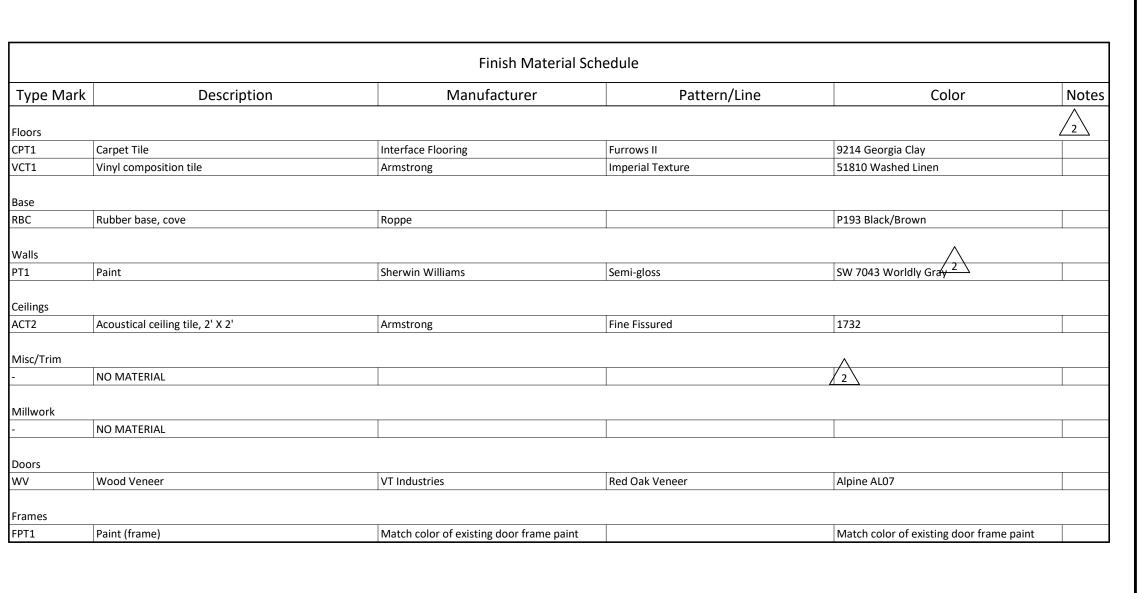


Finish Material Schedule

ACT2

Misc/Trim

Door

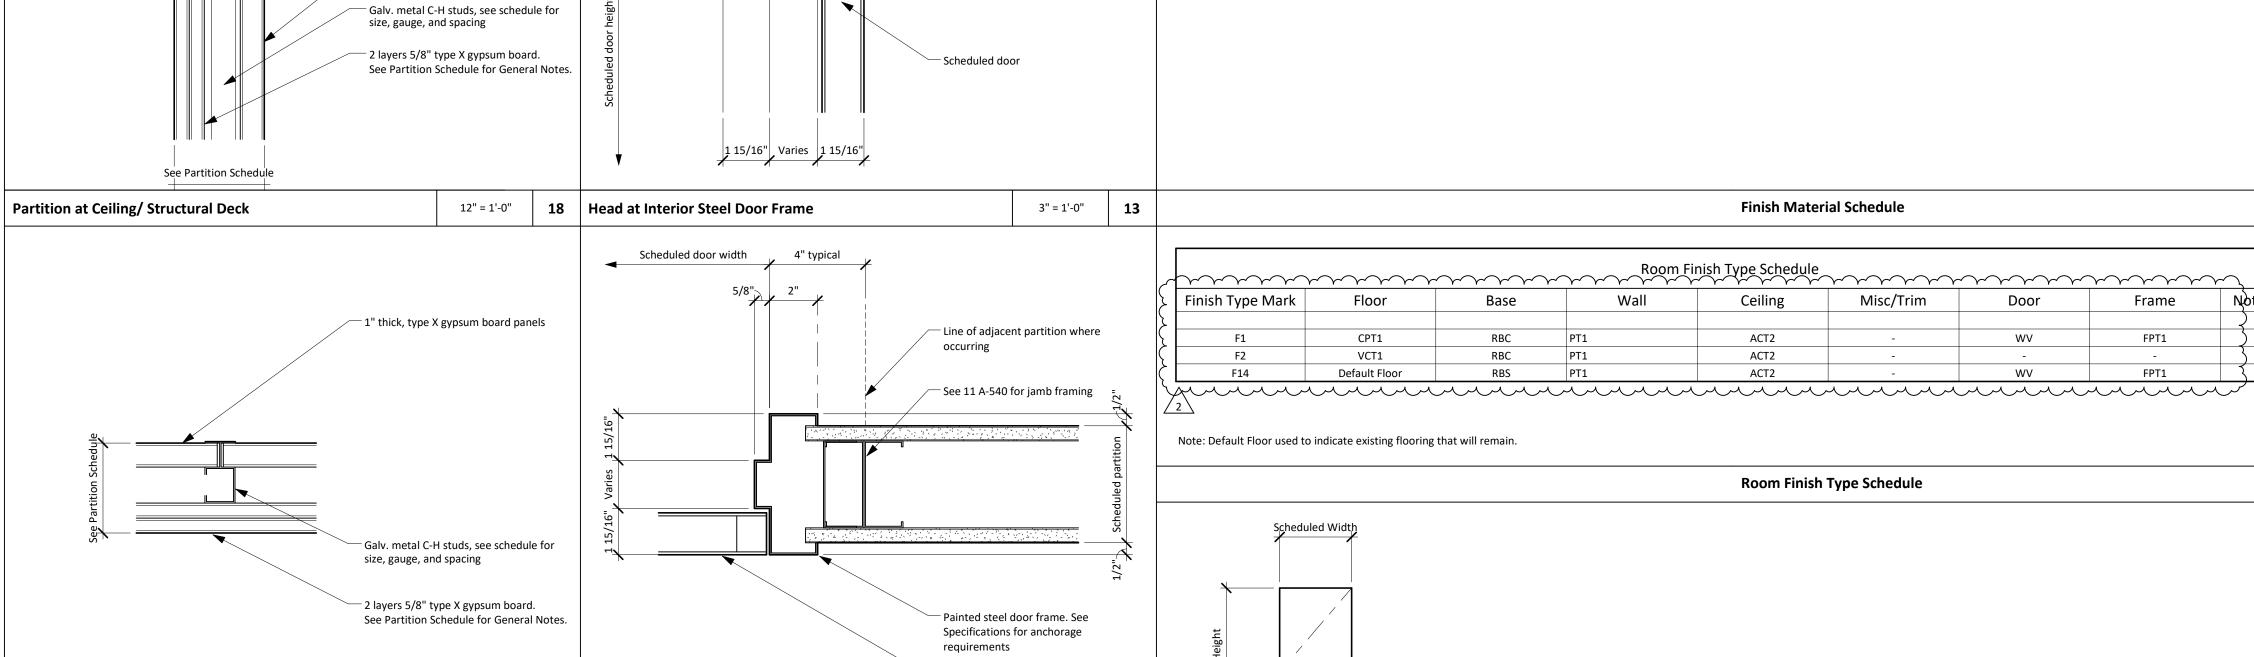

3" = 1'-0" **16** Sill at Interior Steel Door Frame

— Fill voids, see schedule for General Notes

Deflection track with 2" legs or attach studs to track with 1/2" slip-joints

1" thick, type X gypsum board panels

Partition Plan Detail

Partition at Floor

See Partition Schedule

Sealant, see General Notes Attachment to deck at 2'-0" o.c.

					Scheduled door
	12" = 1'-0"	17	Jamb at Interior Steel Doo	or Frame	3" = 1'-0" 12
1 layer 5/8" ty 1-hour partitic type X gypsum partitions. See General Notes Galv. metal C- for size, gauge Attachment to 2'-0" o.c. and	H studs, see schedu e, and spacing o floor or structure a	at " for le	Scheduled door height /2" max.		Painted steel door frame beyond Scheduled door Finish floor Change in floor material and colors to occur under door - install transition strips at all floor material changes
	lant. Where partition		<u></u>	5" Varies 1 15/16"	

3" = 1'-0" **11**

1/2" Scheduled partition 1/2"

See 5 A-540 for head framing

Painted steel door frame

Scheduled ceiling where occurring

Finish Type Mark

VCT1

Note: Default Floor used to indicate existing flooring that will remain. **Room Finish Type Schedule** Door Type Schedule

					Door						Frame					Fire	
								Elev.					Sill		Head	Rating	
Туре		Description	n		Width	Height	Thick.	No.	Mat'l	Finish	Mat'l	Finish	Detail	Jamb Detail(s)	Detail	(min.)	Notes
A00	Interior flush door					7' - 0"	1 3/4"	1	Wood	DPL1	Steel	FPT1	11 A-540	12 A-540	13 A-540	-	
N04e	Interior double egress narrow lite doors				7' - 4"	7' - 0"	1 3/4"	12	Wood	DPL1	Steel	FPT1	16 A-540	18 A-540	17 A-540	-	
Conora	Notes																
Genera	inotes																
1. Se	e detail 5 A-540 for	stud framing around doo	r opening	J .													
	: 01 Office																
Each to																	
-3 EA	Hinge	4 1/2"x4 1/2" TA2714	652	MCK													
-1 EA	Entrance Lock	93K7AB14DS3-626		BES													
-1 EA	FSIC Core Only																
-1 EA	Door Stop	406	630	RCK													
-3 EA	Silencers	609	Grey	RCK													

Door Type Schedule